


A-102 118-130
ZANUSSI CORP OF AMERICA
A-2 #3 1/1180

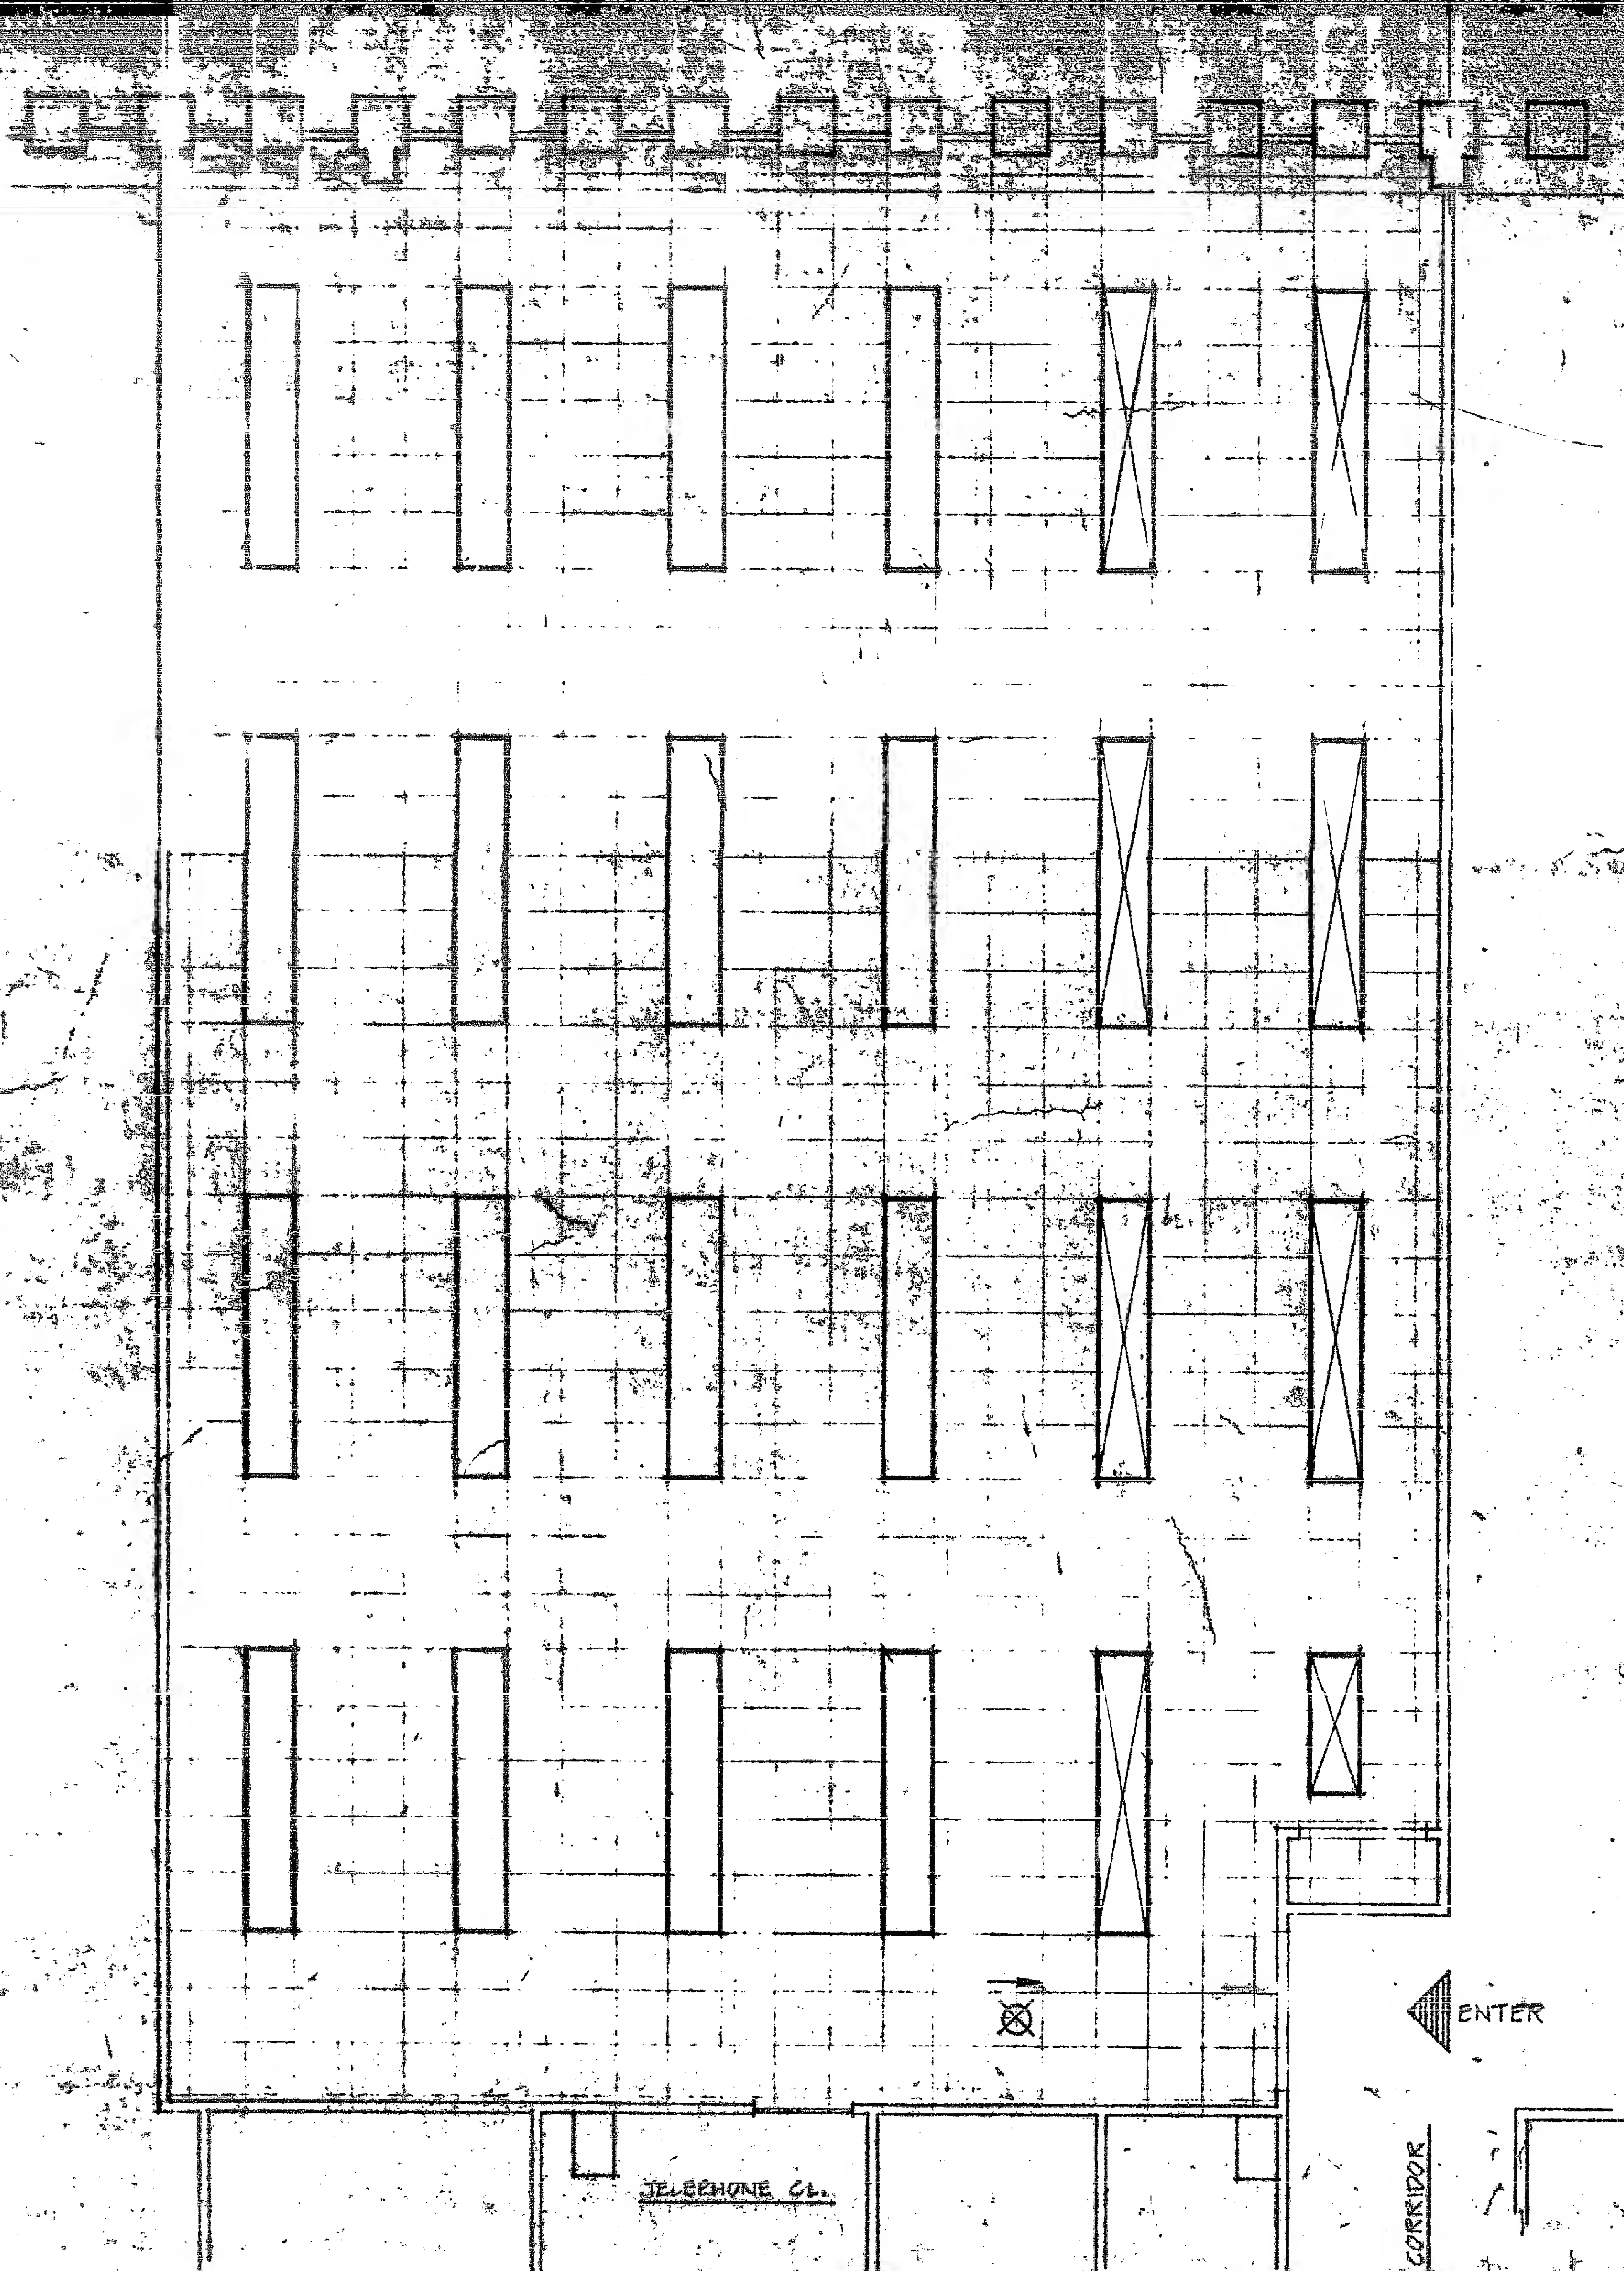

REFLECTED CEILING PLAN

NOTE:
ALL WORK TO BE DONE IN ACCORDANCE WITH
THE NATIONAL ELECTRICAL CODE AND THE N.E.C.

ELECTRICAL NOTES:

1. All conduits to have a minimum of 2 #12 wires (UL Standard #22) and shall be minimum of 3/4" unless otherwise noted.
2. All electrical floor outlet units (housing) shall be set flush on the concrete or vinyl floor.
3. The contractor shall install in all other set fittings, one (2) "Palmer Package" wire stop, one of each side of the nearest baffle.
4. All device plates for wall outlets shall be brass safe finish, smooth aluminum. Device plates for telephone outlets shall contain a bushed hole.
5. Power interruptions and core drilling will be permitted, only between the hours of 8:00 PM and 8:00 AM.
6. Contractor will not be permitted to chase the floor.
7. When installing receptacle outlets, splices and/or connections in the underfloor system shall be made in the header duct only. Contractor shall install a support for each receptacle to the header duct. All unused wiring to be removed and header duct to be removed by the contractor.
8. Circuits that are designated with numbers 1-6 inclusive and 31 and above are not existing in the header duct. Contractor is to install and connect the appropriate quantity of wires, from them to be connected, back to the designated panel via the floor cell and header duct.
9. When installing any special purpose outlets, that are shown connected to circuits other than circuit 7-30 inclusive, the wires shall be installed by the contractor and shall be connected to the designated panel. The contractor shall modify the panel directory to reflect the circuit availability.
10. Minimum distance for all combination telephone/duplex receptacles or on receptacles shall be 12" from walls or connections, unless otherwise indicated on drawings.

11. FOR MATERIALS (ELECTRICAL) FURNISHED BY THE BBT AUTHORITY
SEE DRAWING 8-5



KEY PLAN

